

Conventional Septic Systems Application Package For a Permit To Construct

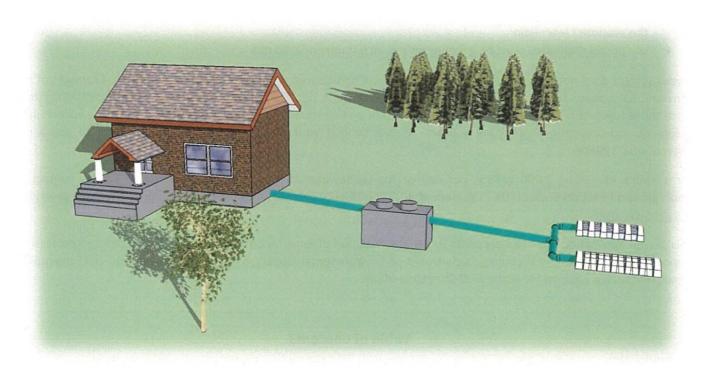



Water Quality Division

Wyoming Water Quality Rules and Regulations, Chapter 25

Introduction

This application package will assist you with submitting a completed application for a permit to install a conventional small wastewater treatment and disposal system. Complete and submit only those pages that are applicable to your system. If you complete the required pages using the information in this design package as accurately as possible, your small wastewater treatment permit application should comply with the minimum requirements of the Water Quality Rules and Regulation, Chapter 25.

DEQ designed this application package for conventional systems (septic tank and leachfield) only. In order to use this package, your system must meet all of the following criteria:

- wastewater flow of less than 2,000 gallons per day of waste containing domestic sewage
- standard trench or bed type disposal systems, using either stone and pipe or chambers
- seasonal high groundwater, bedrock, or impervious clay layers must be four feet or more below the bottom of the proposed leachfield
- soil percolation rates must be ≥ 5 minutes per inch (mpi) and ≤ 60 mpi

If your system does not meet all of these requirements, a non-conventional system may be required. Examples of non-conventional systems are mounded or partially mounded systems, non-discharging ponds, or evapotranspiration systems. Since these types of facilities are more difficult to design and construct, this package does NOT provide guidance in the design of non-conventional disposal systems. Please contact your district engineer if you propose to use a non-conventional system.

For systems exceeding 2,000 gallons per day or for wastewater that is not entirely domestic waste, contact the Underground Injection Control (UIC) Program at 307-777-5623 or refer to: http://deq.wyoming.gov/wqd/underground-injection-control/.

This permit application has been prepared under the direction of Ryan McBride, P.E. # 15068, a registered professional engineer employed by the Wyoming Department of Environmental Quality, Water Quality Division. DEQ maintains a signed and sealed copy on file at the DEQ Cheyenne office.

Table of Contents

Introduction	2
Small Wastewater Treatment Facility Application for Permit to Construct	3
Site Suitability Site Plan Drawing Septic Tank and Piping Worksheet	4
Site Plan Drawing	6
Septic Tank and Piping Worksheet	7
Basic Design Requirements for Septic Tanks	8
Percolation Test Instructions	9
Percolation Test Instructions Percolation Test Data Sheet	10
Leachfield Sizing Worksheet	11
Leachfield Design Instructions	12
Leachfield Sizing Worksheet Leachfield Design Instructions Table 1. Chamber System Equivalent Areas	13
Perforated Pipe Trench Layout	14
Chambered Trench Layout	
Perforated Pipe Bed Layout	
Chambered Bed Layout	20
Attachment 1. Table 2 Excerpted from Water Quality Rules and Regulations, Chapter 25.	22

Reviewed By App. No.	Reviewed By	App. No.	
----------------------	-------------	----------	--

	Small Wa	stewater	Treatment	Facility	y Appli	cation for	Per	rmit to Cor	istruct
Use th					ies treating less than 2,000 gallons per day. For facilities exceeding Injection Control Program (UIC) at 307-777-5623.				
Platte DEQ/ 200 W Cheye	For Converse (commercial systems only), Carbon, Niobrara, an Platte counties, submit completed packages to: DEQ/ Water Quality Division 200 W 17 th Street Cheyenne, WY 82002 (307) 777-7781				WQD Da	te Stamp			
For Campbell (commercial systems only), Crook, and Weston counties, submit completed packages to: DEQ/Water Quality Division 152 North Durbin Street, Suite 100 Casper, WY 82601 (307) 473-3465				WQD Au	thorization Sta	mp			
Autho http://	rity for the corre	ect forms. ov/wqd/permi	mall Wastewater P						
Name	of Project:								
Projec	t Description:								
	County:								
ition:	County: 1/4 1/4 Section:		Section:			Township:		Range	:
Location:		de:	Section:		Decimal	Township: Longitude:		Range	:
Location:	¼ ¼ Section:		Section:	-5000-46				Range	:
Location:	¼ ¼ Section: Decimal Latitue Subdivision Na					Longitude: ot and Block:	inee	Range r/Geologist	
	¼ ¼ Section: Decimal Latitue Subdivision Na	me:				Longitude: ot and Block: Eng	inee		
	¼ ¼ Section: Decimal Latitue Subdivision Na	me:			Lo	Longitude: ot and Block: Eng	inee		
Printe	¼ ¼ Section: Decimal Latitue Subdivision Na	me:		-	Lo Printed Nar	Longitude: ot and Block: Engi	inee		
Printe	¼ ¼ Section: Decimal Latitue Subdivision Na R d Name:	me:		1	Printed Nar	Longitude: ot and Block: Engi	inee		Zip:
Printe Title: Mailin City, S	¼ ¼ Section: Decimal Latitue Subdivision Na R d Name:	me:	wner	1	Printed Nar Title: Mailing Add	Longitude: ot and Block: Enginee: dress:	inee		
Printe Title: Mailin City, S	1/4 1/4 Section: Decimal Latitue Subdivision Na R d Name: g Address: tate:	me:	wner	1	Printed Nar Title: Mailing Add	Longitude: ot and Block: Enginee: dress:	inee		
Printe Title: Mailin City, S Phone	1/4 1/4 Section: Decimal Latitue Subdivision Na R d Name: g Address: tate:	me:	wner	1	Printed Nar Title: Mailing Add City, State: Phone Num	Longitude: ot and Block: Enginee: dress:	inee		
Printe Title: Mailin City, S Phone Email:	1/4 1/4 Section: Decimal Latitue Subdivision Na R d Name: g Address: tate:	me:	wner	1	Printed Nar Title: Mailing Add City, State: Phone Num Email:	Longitude: ot and Block: Enginee: dress:	inee	r/Geologist	
Printe Title: Mailin City, S Phone Email:	% % Section: Decimal Latitue Subdivision Na R d Name: g Address: tate: Number:	me:	wner	1	Printed Nar Title: Mailing Add City, State: Phone Num Email:	Longitude: ot and Block: Enginee: dress:	inee	r/Geologist	
Printe Title: Mailin City, S Phone	% % Section: Decimal Latitue Subdivision Na R d Name: g Address: tate: Number:	me: seal Estate O	wner	1	Printed Nar Title: Mailing Add City, State: Phone Num Email:	Longitude: ot and Block: Enginee: dress:	inee	r/Geologist	

May 2017 Page **3** of **22**

_								
	County:							
	Physical Address:							
	Lot Size:	feet by	feet OR acres					
_	Type of Building:	(single family dwelling, mobile home, co	ommercial, etc.)					
natio		Cistern						
Property Information	Water Source:	Private Well	SEO Well Permit Number:					
perty	(Check One)	Community Well	Name:					
Pro		Municipal Well	Name:					
	Is this a replacement If yes, what are you re	small wastewater treatment facility eplacing?	? Yes No Type replaced:					
	Will this small wastewater treatment facility be located within a delineated source water protection area? Does the county approved plat require enhanced septic systems? If yes, do NOT proceed with this application. Contact your district engineer to discuss other options.							
Provid	le legal description of	property (from sales contract or de	ed) below and attach a copy of the county approved plat.					
THISA								
		Acce	ess Route					
for De where cross a	partment of Environmen the site is located, (ii) p all properties necessary	ntal Quality personnel and their invite permission to collect resource data as	of perjury that the applicant has secured and shall maintain permission es to access the permitted site, including (i) permission to access the land defined by Wyoming Statute § 6-3-414, and (iii) permission to enter and directly accessed from a public road. A map of the access route(s) to the eet.					
		Sig	natures					
Departure access and (in a pub	All undersigned certify under penalty of perjury that the owner or applicant has secured and shall maintain permission for Department of Environmental Quality personnel and their invitees to access the permitted site, including (i) permission to access the land where the site is located, (ii) permission to collect resource data as defined by Wyoming Statute § 6-3-414, and (iii) permission to enter and cross all properties necessary to access the site if the site cannot be directly accessed from a public road. All undersigned agree to comply with all applicable Wyoming Statutes and Regulations and to allow the activities described in this application.							
		state Owner	Engineer/Geologist					
		ure Required)						
Signat			C:					
			Signature:					
	ed Name:		Signature: Printed Name: Title:					

May 2017 Page **4** of **22**

Site Suitability

The owner must be aware of the depth of any impermeable soil layers, high groundwater levels, and slope when considering the septic system location. The septic system must meet the criteria listed in the Introduction (Page 2) for a conventional system to work properly. If your site does not meet these criteria, stop filling out this form and contact your district engineer to discuss other options. The questions below will ensure you have gathered the information necessary to determine if a conventional septic system is appropriate.

	Does the soil exploration pit lie within the area of the proposed leachfield?	Yes No
on	Was the bottom of the required soil exploration pit at least <u>4 feet below</u> the bottom of the proposed leachfield, usually a minimum of 7-8 feet total depth? This is required.	Yes No
Excavation	Take a color photograph of the excavation, showing a tape measure against the sidewall of the trench. Submit a color copy of the photograph as a separate sheet. Photo included in packet?	Yes No
Ex	Depth of the excavation?	
	Who conducted the excavation?	
iyers	Did the excavator observe a rock layer below the surface?	Yes No
able La	If yes, at what depth below the ground surface?	
Impermeable Layers	Did the excavator observe a clay layer below the surface?	Yes No
lmp	If yes, at what depth below the ground surface?	
	Was groundwater present in the excavation?	Yes No
ater	If yes, at what depth below the ground surface?	
High Groundwater	Does the soil have an alkali crust at the surface, a rotten egg smell, or a blue-gray or greenish-gray (gley) color that may indicate frequent/continuous saturation?	Yes No
gh Gro	If yes, at what depth below the ground surface?	
Ĭ	Does the soil have a mottled appearance with areas around roots or cracks that look like rust, or is the soil stained a dark red-black or red-brown color, which may indicate periods of saturation?	Yes No
	If yes, at what depth below the ground surface?	
pe	What is the estimated slope of the proposed leachfield area? Take a color photograph of the proposed leachfield area and attach a copy as a separate sheet.	
Slope	How far away is the nearest break in slope (the side of a hill or where the slope becomes abruptly steeper) from the proposed leachfield area?	
	How far away is the nearest surface water body, such as a lake, river, pond, creek, ditch, or wetland from the proposed leachfield area?	
ler	How far away are areas where the soil may be compacted by vehicles, such as roads or parking spaces, from the proposed leachfield area?	
Other	How far away are water supply wells (drinking or irrigation wells), cisterns, or water supply lines from the proposed leachfield area?	
	Do surface drainage features (ditches, depressions, or swales) direct runoff from paved areas such as roofs, patios, or driveways, away from the leachfield?	Yes No


May 2017 Page **5** of **22**

Site Plan Drawing

Attach a sketch of your site as a separate sheet, showing each of the items in the table below if applicable.

Check Box If Shown On Site Plan	Element	Required Setback Distance To Septic Tank (feet)	Required Setback Distance To Leachfield (feet)	Dist	Setback cance sfied?
	Property lines	10	10	☐ Yes	□ No
	All buildings, roads, and driveways		_	_	
	Setback to buildings w/out a foundation drain	5	10	☐ Yes	□ No
	Setback to buildings with a foundation drain	5	25	☐ Yes	□ No
	Private wells (including neighbors)	50	100	☐ Yes	□ No
	Public water supply wells	100	200	☐ Yes	□ No
	Potable water supply lines	25	25	☐ Yes	□ No
	Surface water (ditch, pond, Intermittent waterways, etc.)	50	50	☐ Yes	□ No
	Septic tank	_	10	☐ Yes	□ No
	Break in slope (where slope gets abruptly steeper)	1 5	15	☐ Yes	□ No
	Cisterns	25	25	☐ Yes	□ No
	Leachfield & Replacement Leachfield	10	_	☐ Yes	□ No
	North arrow	_	_		_
	Slope (arrow pointing downslope)	_	-		_
	Location of numbered percolation test holes (numbered)	_	_		-
	Location of soil exploration pit	_			-
	Location of cleanout port(s)	_	1 <u></u>		-

Example site plan: Please see our Site Plan Mapping Tool on our website!

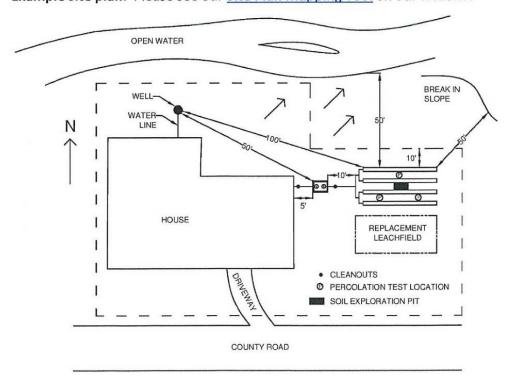

May 2017 Page **6** of **22**

Septic Tank and Piping Worksheet


Manufacturer:															
	Model No Chamber	o./Number of s:													
	Size (gall	ons):													
	Tank Ma	terial:		Concrete	□ Fi	berglass		hermop	lasti	c 🗆 Oth	er (please des	scribe):			s .
	Is this sep	otic tank on the	appr	oved list?						☐ Yes	□ No [□ Don	't Know	,	
	If no, provide a tank diagram from the manufacturer. If you cannot locate a diagram from t following 3 rows. See Page 8 for septic tank design requirements and a diagram of a septic										facturer	, compl	ete the		
Septic Tank	olete VI on list.	Internal Dime	nsion	s: Length ((in): _		w	idth (in):	н	leight (in):		_		
	Please complete for tanks NOT on approved list.	Liquid Depth (in):				Amou	unt of	Air Spa			op of Liquid r Ceiling (in)				
ptic	Plea for to	Operating	(_		* _		*			0.5	÷ 231 =				ns
Se	Double of	Capacity		ength (in)		Width (i	in)	Liquid	Dep	oth (in)	Oper	ating C	Capacity		
		f backfill over to um of 6" require					Num	ber of l	oedro	ooms, if a	residence:				
	If more than 4 bedrooms: Does the tank have additional capacity of 150 gallons per additional bedroom above 1,000 gallons?									per		Yes		No	
	Does the tank have a 20-inch access opening in <u>EACH</u> compartment of the tank and a riser from the access opening that terminates at a max of six (6) inches below the ground surface?										Yes		No		
	Is septic tank installed on a level grade, with firm bedding to prevent settling, and without rock or other obstructions touching the tank as per WQRR Chapter 25, Section 10(a)(ii)?										Yes		No		
	If installing two tanks in a series, install the downstream tank a minimum of 2 inches lower than the first to insure proper flow. Will the installer use a series of tanks as described?									Yes		No			
	Do access openings have a locking device?									Yes		No			
		I the piping mat d the septic tan			ne		为一人的企业			at is the person of the size (dia					
	Will the i	nstaller lay the	pipe 1	from the ho	ouse	to the se	eptic t	ank in a	stra	ight line?			Yes		No
	The state of the s	the installer in degrees?	clude	the <u>requir</u>	ed cl	eanout p	oorts a	at any a	lignn	nent char	nge greater		Yes		No
	Will the p	pipe from the h	ouse '	to the sept	ic tar	nk be mo	ore tha	an 100 f	eet l	ong?			Yes		No
Piping	If yes, wi	I the <u>required</u> o	lean	out ports b	e spa	ced alor	ng the	line ev	ery 1	00 feet o	r less?		Yes		No
		mmends a clea e is used, which		,							d the tank.		oward B oward T		
	Will the p	oiping have a m	inimu	m slope of	¼ in	ch per fo	oot (29	%)?					Yes		No
		taller uses more ualize flow. Wi											Yes		No
	Will the I	tee to equalize flow. Will the system include a distribution box or flow divider tee? Will the leachfield trenches be less than 100 feet long? This is required.										Yes		No	

May 2017

Basic Design Requirements for Septic Tanks

- 1. Tanks must have a minimum of a 1,000-gallon capacity for residences with up to four bedrooms; add 150 gallons of capacity for each additional bedroom.
- The tank must be watertight, including all joints and connections, and constructed of a durable, non-corrodible
 material such as concrete, fiberglass, thermoplastic or other approved material. DEQ regulations do not allow
 steel tanks.
- 3. The liquid depth shall be between three (3) and six (6) feet deep.
- 4. A single chamber tank shall have at least a 2:1 length to width ratio or be partitioned to prevent short-circuiting.
- 5. The first chamber in any two-chambered tank must accommodate at least 50 percent of the capacity.
- 6. Each chamber must have an access opening with a minimum dimension of 20 inches, from which both inlet and outlet tees shall be accessible.
- 7. Each chamber must have a cleanout riser that extends to a maximum of six (6) inches below the ground surface.
- 8. The inlet and outlet tees should be 4-inch diameter, schedule 40 PVC or equivalent, and should extend into undisturbed soil.
- 9. Install tanks used in a series such that the inlet to each successive tank shall be at least two (2) inches below the outlet of the preceding tank.

Diagram of a Typical Two-Chambered Septic Tank

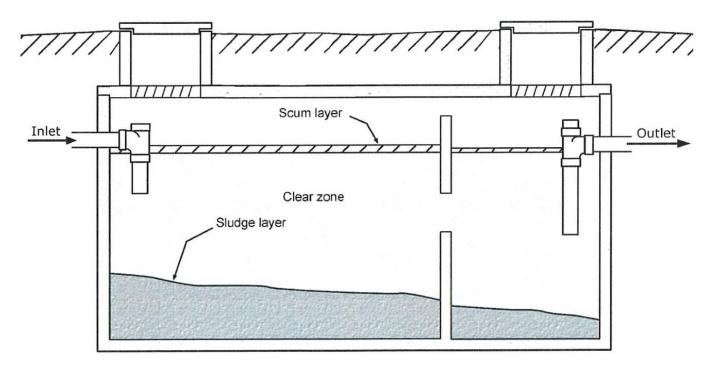

Drawing modified from CIDWT. 2009. *Installation of Wastewater Treatment Systems*. Consortium of Institutes for Decentralized Wastewater Treatment (CIDWT). Iowa State University, Midwest Plan Service. Ames, IA.

May 2017 Page 8 of 22

Percolation Test Instructions

In order for a septic system to perform properly, the wastewater must move through the soil at an ideal rate, neither too fast nor too slow. A percolation test estimates the rate at which the water will percolate, or move, through the soil. The information provided by percolation tests is necessary to design leachfields correctly. Follow the steps below to complete a percolation test.


- 1. Location of Percolation Test Holes. The percolation (perc) test holes must be spaced uniformly over the proposed leachfield site. A minimum of three (3) test holes are required, although you can use more if desired.
- 2. Test Hole Preparation. Dig or bore each hole 12 inches wide and as deep as the proposed depth of the leachfield (usually between 30 and 40 inches). Make sure the sides are vertical and scrape the sides and bottom of the hole with a sharp pointed instrument to restore a natural soil surface. Remove loose soil from the hole and place 2 inches of course sand, washed gravel, or crushed stone in the bottom in order to prevent scouring or sealing.
- **3. Presoaking.** Presoaking is <u>absolutely</u> required to get valid percolation test results. Presoaking allows the water conditions in the test hole to reach a stable condition that is similar to a leachfield. Presoaking time varies with soil conditions, but presoak holes for at least 4 hours. Maintain at least 18 inches of water in the test holes for at least 4 hours, then allow the soil to swell for 12 hours (overnight is good) before starting the perc test.

For sandy or loose soils, add 18 inches of water above the gravel or coarse sand. If the 18 inches of water seeps away in 18 minutes or less, add 18 inches of water a second time. If the second filling of 18 inches of water seeps away in 18 minutes or less, the soil is excessively permeable and the site is unsuitable for a conventional disposal system. If this is the case, contact your county small wastewater permitting authority or DEQ district office.

4. Perc Rate Measurements. Fill each hole with 12 inches of water and let the soil re-hydrate for 15 minutes prior to taking any measurements. Establish a fixed reference point such as a flat board placed across the top of the hole to measure the incremental water level drop at the constant time intervals. Measure the water level drop to the nearest 1/8 of an inch with a minimum time interval of 10 minutes. Normal time intervals are usually 10 or 15 minutes.

Refill the test hole to 12 inches above the gravel before starting the measurements. Measure down to the water from the fixed reference point. Record this value on the first line in the perc test data sheet (Page 10). Take another measurement after the time interval has elapsed and record on the second line of the table. Calculate the water level drop and record in the table.

Continue the test until the water level drop rate has stabilized, i.e. three consecutive measurements within 1/8 inch of each other. Before the water level drops below 1 inch above the gravel, refill the test hole to 12 inches. Some test holes may take longer to stabilize than others. If the drop rate continues to fluctuate, use the smallest drop rate out of the last six intervals for your calculations.

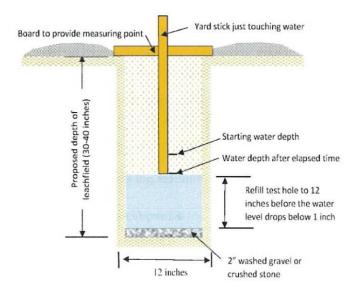

May 2017 Page **9** of **22**

Percolation Test Data Sheet

Owner/F	Project N	ame:					00024						
Test hole	es were p	ore-soake	ed for:		(hour	s/minute	es)		Time	Interval:_		_ min	
		percolatio											
and eve	nly space	d over the Hole (Requ	e #1	Hol	Roughen : e #2 uired)	Hol	e #3 uired)	Hol	e #4 ional)	Hol	e #5 onal)		e #6
Depth	of Hole:									2 2 5 12 - 1			
Time	Time		Measure to nearest 1/8 inch		Measure to nearest 1/8 inch		Measure to nearest 1/8 inch Water Level		Measure to nearest 1/8 inch Water Level Drop		ure to 1/8 inch	Measure to nearest 1/8 inch	
of Day	(Min)	Water Level Drop		Water Level Drop							Water Level Drop		Water Level Drop
			-		_		-		_		-		_
		ar a s				Tan Ti					Fig. 1		
		A.M.				Total I	T and			a.Wali	9704000		
		10-10-11	M. F										
										10.44			
	nterval utes)												
Final I	nterval inches)												
Perc	Rate (inch)		9 19 20 1				-						
(,								-	erc Rate (inch)				
measure	ment at	p: Subtrathe end. nt for eac	The "Dro	p" is hoν	w far the	water le							
	1700000	ation (Pe were tes					use the s	slowest (highest n	number) i	ate of th	e holes t	ested. I
Helpful (Conversi	ons: 1/8	3 = 0.125	1/4 =	0.25 3,	/8 = 0.37	5 1/2 =	0.50 5	/8 = 0.62	25 3/4 :	= 0.75	7/8 = 0.8	175
Γο calcul	ate perc	rate (mir	nutes pe	r inch): T	ime Inte	rval (min)	÷ Final	Interval D	rop (in)				
			Exampl	e Perc Ro	$ate = \frac{1}{Fi}$	Time Inte nal Inter	erval (m val Drop	$\frac{(in)}{(in)} = \frac{1}{1}$	$\frac{0\ min}{\frac{1}{8}\ in} =$	$8.9 \frac{min}{in}$			
certify th	nat this p	erc test wa	as done ir	n accordar	nce with V	VQRR Cha	pter 25, <i>F</i>	Appendix /	A and the	instructio	ns on the	previous	page.
Test Per	formed b	ру:					Signa	ture:					
May 2017													10 of 22

Leachfield Sizing Worksheet

Design Flow (gpd)	Please Select Building Type:	Residential Building (Including Mobile Homes)		How many bedrooms of the residence have? bedrooms Does the residence have unfinished basement? Yes No If yes, add 2 more bedrooms to the number above. Total bedrooms	Enter the number of gallons per day (gpd) of wastewater generated that corresponds with the number of bedrooms in Box 1 below. 1 bedroom 150 gpd 2 bedrooms 280 gpd 3 bedrooms 390 gpd 4 bedrooms 470 gpd 5 bedrooms 550 gpd 6 bedrooms* 630 gpd *Add an additional 80 gallons per day for each bedroom over 6.			
	A CONTRACTOR OF THE PARTY OF TH	gn Flow (gpd):	dential Building	Refer to Chapter 25, Ta necessary.	ble 2. Sh	now calcu	lations and attac	h a separate sheet if Box 1
	Enter	value from cells a	oove or Chapter 25	, Table 2 (attached):				
	e 10)	Perc. Rate min/inch gpd/ft²		Perc. Rate min/inch	Loading Rate gpd/ft²		Perc. Rate min/inch	Loading Rate gpd/ft²
	t (pag	O 5	0.80	O 16	0.	50	O 30-31	0.39
	Shee	O 6	0.75	O 17	0.	49	O 32-33	0.38
	. Data	O 7	O 7 0.71 O 1		0.	48	O 34-35	0.37
1/ft²)	c Test	O 8	0.68	O 19	0.47		O 36-37	0.36
Loading Rate (gpd/ft²)	n Per	O 9	0.65	O 20	0.	46	O 38-40	0.35
Rate	d fro	O 10	0.62	O 21	0.	45	O 41-43	0.34
ling	taine	O 11	0.60	O 22	0.	44	O 44-46	0.33
Loac	te Ob	O 12	0.58	O 23-24	0.	43	O 47-50	0.32
	erc Ra	O 13	0.56	O 25	0.	42	O 51-55	0.31
	eck Pe	O 14	0.54	O 26 - 27	0.	41	O 56-60	0.30
	ਚੰ	O 15	0.52	O 28 - 29	0.	40		
	100000000000000000000000000000000000000	ing Rate (gpd/ loading rate for ye		e from above table.				Box 2
Leachfield Sizing (ft²)	Divide rate (I	uired Leachfield de design flow (Box Box 2). Round <u>up</u> number.	1) by loading	Design Flow (Box 1) ÷ Example: 3			= px 2) = Leachfield pd/ft² = 483.87	

Leachfield Design Instructions

Arrange conventional septic system leachfields using either a trench or a bed layout. Construct either trench or bed layouts using either perforated pipe or open-bottom chamber systems. DEQ prefers trench layouts because they provide more surface area for absorption of wastewater into the soil. Trenches also treat wastewater more efficiently because the undisturbed soil between the trenches allows more oxygen to reach the microbes that break down and treat the wastewater. For this reason, trenches are also more effective when soils have lower or "slower" percolation rates. Use bed layouts where space for a leachfield is limited and only where soils have higher or "faster" percolation rates. DEQ considers trenches spaced less than three (3) feet apart as bed layouts.

To design your leachfield, follow these steps:

- 1) Choose either a trench or a bed layout.
- 2) Choose either perforated pipe or open-bottomed chambers for your leachfield.
- 3) Fill out the layout worksheet and diagram that correspond to your selection. This worksheet will determine how many trenches you need or how large to make your bed.
- 4) Submit only the worksheet and diagram that you completed.

Trench Leachfield System:

Perforated Pipe Trench Layout Worksheet, Page 14 Chambered Trench Layout Worksheet, Page 16


Bed Leachfield System:

Perforated Pipe Bed Layout Worksheet, Page 18 Chamber Bed Layout Worksheet, Page 20

Install leachfields to ensure equal distribution of wastewater effluent among all the trenches. Equal distribution allows the use of the entire infiltrative surface of the leachfield and prevents overloading part of the leachfield.

Use either a piping header or distribution box (D-box) to distribute wastewater effluent equally among the trenches of a leachfield. A piping header system conveys wastewater effluent to each disposal trench using a network of solid piping. Split the discharge line from the septic tank using a T-pipe fitting (see example below). If there is an odd number of trenches in the leachfield, use a distribution box to divide wastewater effluent evenly among the trenches (see example below). Distribution boxes are typically made of concrete or wastewater-grade plastics and are watertight with a single inlet set at a higher elevation than the outlets. Construct outlets so that their elevations are equal relative to one another.

Examples of Septic Systems Where the Effluent is Distributed Equally.

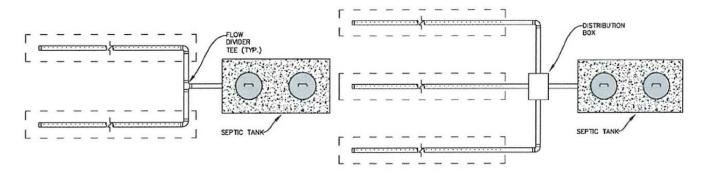

DEQ does not require installation of leachfield trenches in a straight line. In fact, it is always preferable to follow the contour of the land. Additionally, never install the leachfield in floodways, at the base of slopes, or in depressions where runoff water could flood the leachfield. Construct leachfields in areas with good surface drainage, where the water cannot pond over the leachfield.

Table 1. Chamber System Equivalent Areas

Wyoming DEQ Rules and Regulations Chapter 25 Section 8 allows for a 30% reduction in the leachfield area when using chambers in place of traditional pipe and stone systems. To calculate the reduction in square footage required to achieve the same amount of infiltrative surface as pipe trenches or beds, use the dimensions provided by the chamber manufacturer. In a trench configuration, the equivalent area is equal to Length * [(Chamber Width * 1.43) + (2 * Effective Sidewall Height)]. In a bed configuration the sidewall is not counted, so the equivalent area is equal to Length * (Chamber Width * 1.43). Use dimensions provided in the table below to design leachfields utilizing chamber technology on pages 16 (chamber trenches) or 20 (chamber beds) of the application package.

		Nomi	nal Dimer	nsions	Effec	tive Dime	Equivalent Area		
Chamber Class	Chamber Name	Length	Width	Height	Length	Width ¹	Height ²	Trench Layout	Bed Layout
		(ft)	(in)	(in)	(ft)	(in)	(in)	(sf/unit)	(sf/unit)
9 × 55	Quick4 High Capacity	4.4	34	16	4.0	34	11.5	23.9	16.2
High	Quick4 Plus High Capacity	4.4	34	14	4.0	34	8.0	21.5	16.2
Capacity	Arc 36 High Capacity	5.3	34	16	5.0	34	10.5	29.0	20.3
	BioDiffuser 16" High Capacity	6.3	34	16	6.2	34	11.2	36.7	25.1
	Quick4 Standard	4.4	34	12	4.0	34	8.0	21.5	16.2
s	Quick4 Plus Standard	4.4	34	12	4.0	34	8.0	21.5	16.2
Standard	Arc 36	5.3	34	13	5.0	34	7.0	26.1	20.3
	BioDiffuser 11" Standard	6.3	34	11	6.2	34	5.8	31.1	25.1
Standard	Quick4 Plus Standard LP	4.4	34	8	4.0	34	3.3	18.4	16.2
Low Profile	Arc 36 LP	5.3	34	8	5.0	34	3.8	23.4	20.3
	Quick4 Equalizer 36	4.4	22	12	4.0	22	6.0	14.5	10.5
Narrow	Arc 24	5.6	22	12	5.0	22	6.3	18.3	13.1
	BioDiffuser Bio 3	7.3	22	12	7.2	22	6.4	26.5	18.9
Narrow LP	Quick4 Plus Equalizer 36 LP	4.4	22	8	4.0	22	3.3	12.7	10.5
	Quick4 Equalizer 24	4.4	16	12	4.0	16	6.0	11.6	7.6
Ultra- Narrow	Arc 18	5.6	16	12	5.0	16	6.3	14.7	9.5
	BioDiffuser Bio 2	7.3	16	12	7.2	16	6.4	21.3	13.7
Ultra- Narrow LP	Quick4 Equalizer 24 LP	4.4	16	8	4.0	16	2.0	9.0	7.6

¹The equivalent areas calculation used the outside width of the chamber.


May 2017 Page **13** of **22**

²The effective height is the height of the slotted sidewall of the chamber or depth below the flow line of the inlet pipe, whichever is less.

Perforated Pipe Trench Layout Worksheet

	Required Leachfield Area (Page 11, Box 3)			Box 1							
	Depth of Trench Below Pipe (ft)			Box 2							
E.6	Width of Trench (ft)			Box 3							
Design	Absorptive Area Per Linear Foot of Trench (ft²/ft)	+Trench Depth (Box 2) Tre	+ + + = = = ench Depth (Box 2) Trench Depth (Box 2) Trench Width (Box 3) Absorptive Area								
	Total Trench Length (ft)	Required Leachfield Area (Bo	* Absorptive Area (E	Box 5 = Total Trench Length							
out		Total Trench Length (ft) (from Box 5)	Minimum Number of Trenches to Use	Box 6 Number of Trenches to Use =							
Trench Layout	Number of Trenches to Use	<101 101-200	1 2	Length of Trenches =							
Trenc		201-300 301-400 401-500	3* 4 5*	*A distribution box, or D-box, is required when an odd number of trenches is used.							
		501-600	6	The same of the sa							


Please fill in the boxes on the diagram below.

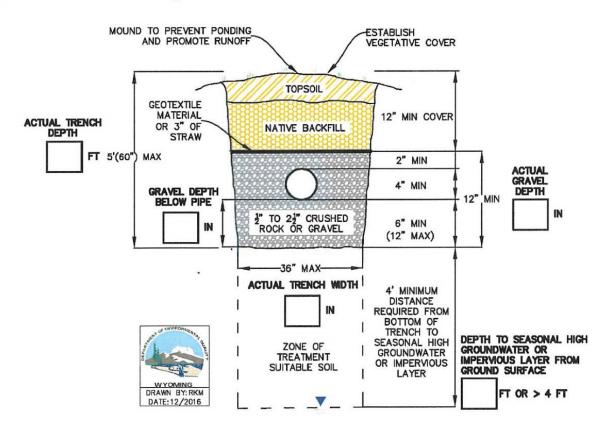

May 2017 Page **14** of **22**

Perforated Pipe Trench Layout Diagram

Example Layout Diagram

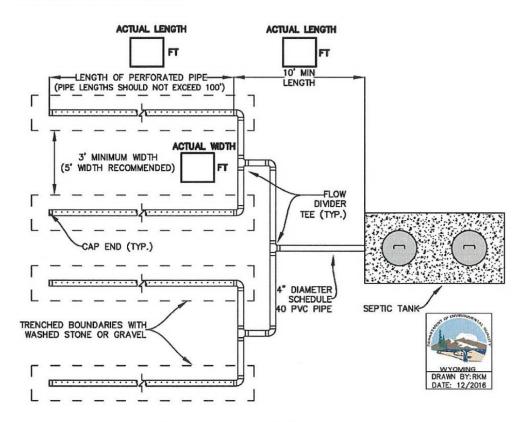


Draw your perforate pipe trench layout below or attach a separate sheet.

Chambered Trench Layout Worksheet

	Manufacturer				
;e 13)	Model				
Chamber (See Table 1, Page 13)	Nominal Length (ft)				
Char	Nominal Width (in)				
See T	Nominal Height (in)				
	Effective Length (ft)				Box 1
	Required Leachfield Area (Page 11, Box 3)				Box 2
Design	Equivalent Area Per Unit (See Table 1, Page 13)				Box 3
٥	Number of Chambers		÷	= =====================================	Box 4 Number of Chambers (Round Up)
		Required Leachfield Area	(Box 2) Equivalent Are	a Per Unit (Box 3)	Box 5
	Total Trench Length (ft)		*	=	
		Number of Chambers (B	ox 4) Effective L	ength (Box 1)	Total Trench Length
Trench Layout		Total Trench	Minimum Number		Box 6
ayc		Length (ft)	Of Trenches		
7		(from Box 5)	to Use	Number of Tr	enches to Use =
nc		<60	1		
re	Number of Trenches to Use	61-120	2	Length of Tre	nches =
		121-180	3*	* A 1' A 'I . '	- L D L iii
		181-240	4		n box, or D-box, is required
		241-300	5*	when an odd	number of trenches is used.
		301-360	6		


Please fill in the boxes on the diagram below.

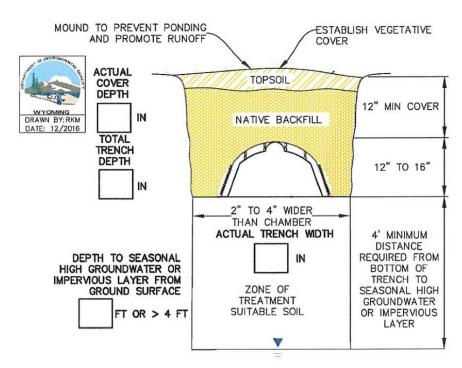

May 2017 Page **16** of **22**

Chambered Trench Layout Diagram

Example Layout Diagram

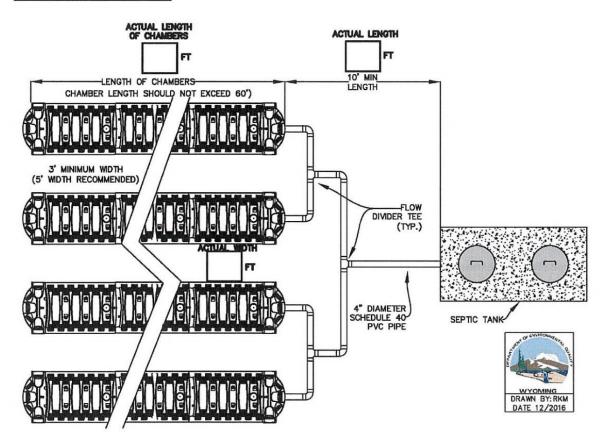


Draw your chambered trench layout below or attach a separate sheet.

Perforated Pipe Bed Layout Worksheet

Design	Required Leachfield Area (Page 11, Box 3)		Box 1			
	Total Excavated Depth (ft)					
	Depth below pipe (ft)					
Bed Layout	Bed Width (ft)		Box 2			
	Bed Length (ft)		Box 3			
	Bed Total Square feet	* =	Box 4			
		Bed Width (Box 2) Bed Length (Box 3) Total Bed Area				
	Is Box 4 greater than or equal to Box 1	Yes No				
	If No, adjust Bed Width	(Box 2) and Bed Length (Box 3) until Box 4 is greater than Box 1				
	If Yes, Complete bottom of Page 18					


Please fill in the boxes on the diagram below.

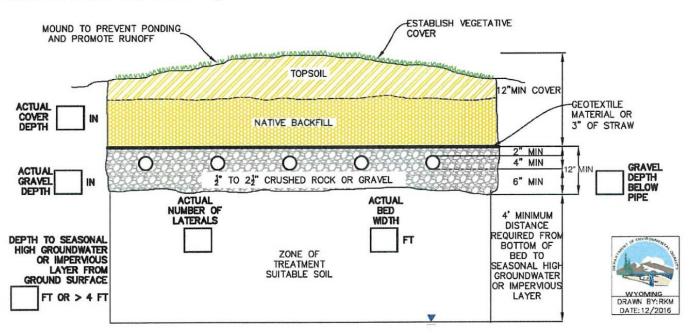

May 2017 Page **18** of **22**

Perforated Pipe Bed Layout Diagram

Example Layout Diagram

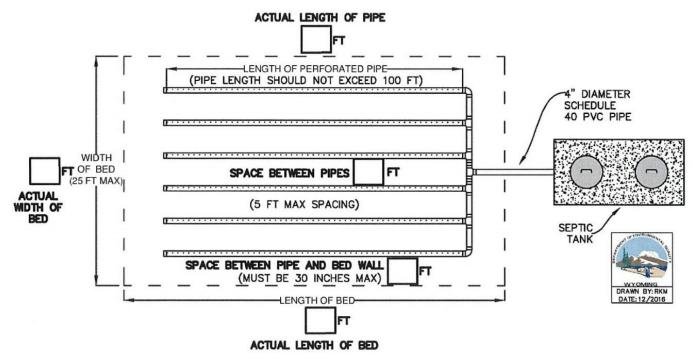


Draw your layout below or attach a separate sheet.

Chambered Bed Layout Worksheet


Chamber (See Table 1, Page 13)		Manufacturer				
	ge 13	Model				
	1, Pag	Nominal Length (ft)				
	able	Nominal Width (in)				
	See T	Nominal Height (in)				
	_	Effective Length (ft)			Box 1	
Design		Required Leachfield Area (Page 11, Box 3)			Box 2	
		Equivalent Area Per Unit (See Table 1, Page 13)			Box 3	
		Number of Chambers	Required Leachfield Area (Box 2) Equivalent Area Per Unit (Box 3) Number of Chambers (Round Up)			
Bed Layout					Box 5	
		Total Chamber Length (ft)		*	=	
			Number of Chambers (Box	x 4) Effective Le	ngth (Box 1) Total Chamber Length Box 6	
		Number of Chamber Rows to Use	Total Chamber Length (ft)	of Chamber Rows	BOX 6	
			(from Box 5)	to Use	Number of Chamber Rows to Use =	
			<60	1		
			61-120	2	Length of Rows =	
			121-180	3*		
			181-240	4	*A distribution box, or D-box, is required	
			241-300	5*	when an odd number of trenches is used.	
			301-360	6		

Please fill in the boxes on the diagram below.

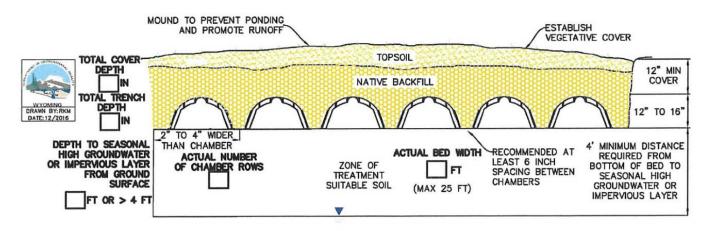

Chambered Bed Layout Diagram

Example Layout Diagram

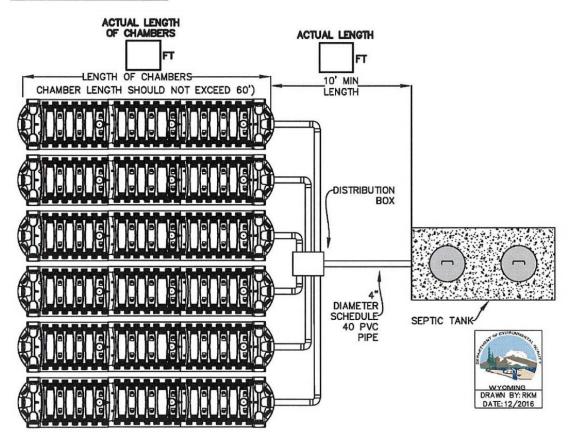

Draw your chambered bed layout below or attach a separate sheet.

Attachment 1. Table 2 Excerpted from Water Quality Rules and Regulations, Chapter 25.

Non-Residential Wastewater Design Flow Rates (Table 2 Excerpted from Water Quality Rules and Regulations, Ch. 25)1

Facility	Unit	Flow (gallons/unit/day)
Airports	person	4
Apartment	bedroom	120
Automobile Service Station	vehicle served	10
Bars	seat	20
Bathhouses and swimming pools	person	10
Campgrounds (w/ toilets only)	person	25
Campgrounds (w/shower facility)	person	45
Church	person	4
Country Club	member	25
Day School, Office Building, Retail Store, Warehouse (no showers)	person	15
Hospital	bed	250
Industrial Building (sanitary waste only)	employee	20
Laundry (self-service)	machine	450
Mobile Home	bedroom	see Table 1
Motel, Hotel, Resort	bedroom	140
Recreational Vehicle	each	100
Rest Home, Care Facility, Boarding School	bed	100
Restaurant	meal	10
Restaurant (kitchen waste only)	meal	6
Theater	seat	3

¹Values shown in the above table are the typical flow rates from *Wastewater Engineering Treatment and Reuse*, Metcalf and Eddy, 2003.